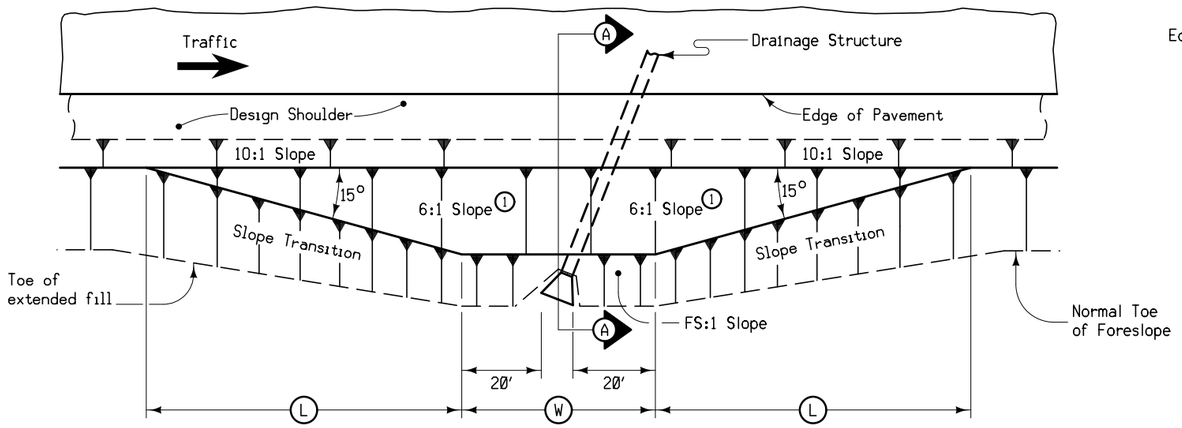

PLAN VIEW

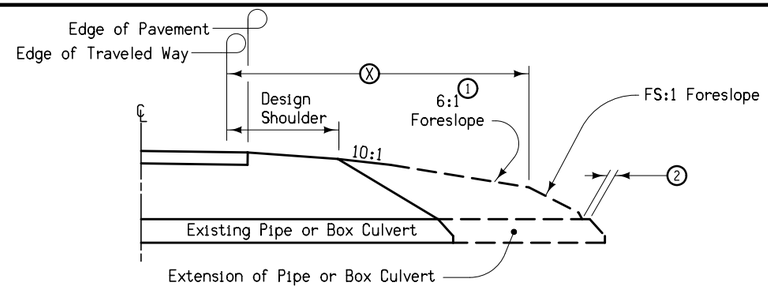

SECTION A-A

STRUCTURE LOCATION		(W)	(L)	(X)	(FS)
STATION (3)	SIDE	Feet	Feet	Feet	

DESIGNER INFO

4312
10-15-19

At locations where an extended or newly constructed drainage structure extends beyond the normal foreslope cover, flatten as indicated so as to cover the structure. Minimum earth cover is 6 inches.

(1) Slope may be flatter than 6:1.

(2) 6 inch minimum for pipe installations or to top of headwall on RCB.

(3) At ℄ of roadway.

(W) = Pipe or RCB opening width plus 20 feet each side.

BARNROOF FORESLOPE AT SKEWED DRAINAGE STRUCTURE