




REINFORCING BARS		
Size "D" mm	Bar Size	Number Required
300 - 525	10	4
600 - 1050	10	8
1200 - 2100	15	8


TYPICAL PLAN WITH ELBOW

TYPICAL PLAN WITH "D" SECTIONS










TYPE "D" SECTION (SINGLE BEVEL)

TYPE "D" SECTION (DOUBLE BEVEL)

DETAILS OF HALF PIPE SECTION

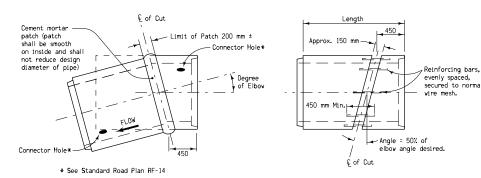

TYPICAL CONCRETE PIPE ELBOW

SPECIAL NOTE:

For pipe sizes up through 1200 millimeters in diameter, bends may be accomplished in increments of 7.5 degrees by using standard "D" sections in appropriate combinations.

For pipe sizes from 1350 millimeters through 1800 millimeters in diameter, the "D" section shall be as specified, limited to a maximum of 5 degree mitter on any one end of pipe section.

For pipe sizes through 1200 millimeters in diameter, bends from 15 to 45 degrees may be accomplished using a single elbow. Bends more than 45 degrees require two elbows unless approved otherwise by the Engineer.

The Contractor may substitute an approved elbow for "D" section bends of 15 degrees or less. Such elbows will not be measured for payment but shall be considered incidental to price bid for culvert pipe.

GENERAL NOTES:

Concrete pipe elbows and Type "D" pipe sections shall be fabricated in conformance with Standard Road plan RF-1 for the size and class of pipe specified

Wire reinforcing shall meet the requirements of AASHTO M 32.

Degree of elbow required shall be as indicated on detail plan for each individual installation.

Minimum length of elbow shall be 1.7 meters measured along centerline of pipe. Design length of pipe shall be considered 1.8 meters.

Elbows shall be fabricated by a method approved by the Engineer and resulting in a finished product essentially as indicated hereon. The typical method for fabricating elbow is as follows: Steel rods, as specified, shall be attached to the normal wire reinforcing cage as indicated hereon. After pipe is cast, a cut 50% of the degree of elbow desired shall be made as indicated, and the reinforcing rods and mesh cut on centerline of the cut. The severed section of pipe shall then be rotated 180 degrees and the reinforcing rods rewelded to the opposite rods. The remaining opening shall then be patched with cement mortar to effect a satisfactorily completed elbow as shown.

Unless specified otherwise, the Type "D" section shall be beveled on a 7.5 degree miter and the bevel may be provided on either the tongue end or groove end of the pipe. In certain cases, both ends of the pipe section may require the beveledend.

Type "D" pipe sections shall be included in measurement for pipe culvert. No payment shall be made specifically for the Type "D" section bevel. It shall be considered incidental to the price bid.

Half Pipe shall conform to the requirements for 100 D as shown on Standard Road Plan RF-1 for the size specified. Maximum "D" size for Half Pipe is 1200 millimeters. Unless specified otherwise, Half Pipe shall be fabricated with connector holes as indicated.

Minimum length of Half Pipe section shall be 1.2 meters. The minimum number of 1.2 meter sections shall be used to make up the necessary length of Half Pipe Flume as indicated on detail plans. Normal length shall be 1.8 meters.

Price bid for Half Pipe, per meter, shall be considered full compensation for furnishing and Installing Half Pipe in accordance with plan requirements.

All dimensions given in millimeters unless noted.

