


- ① Fill annular space with non-shrink grout.
- ② Outlets through intake walls to be CMP; corrugated, double-walled HDPE; or PVC.
- ③ Extend outlet pipe into structure as required to install removable rodent guard grate. Rodent guard grates complying with Iowa DOT Materials I.M. 443.01 are required for pipes 6 inches and smaller.

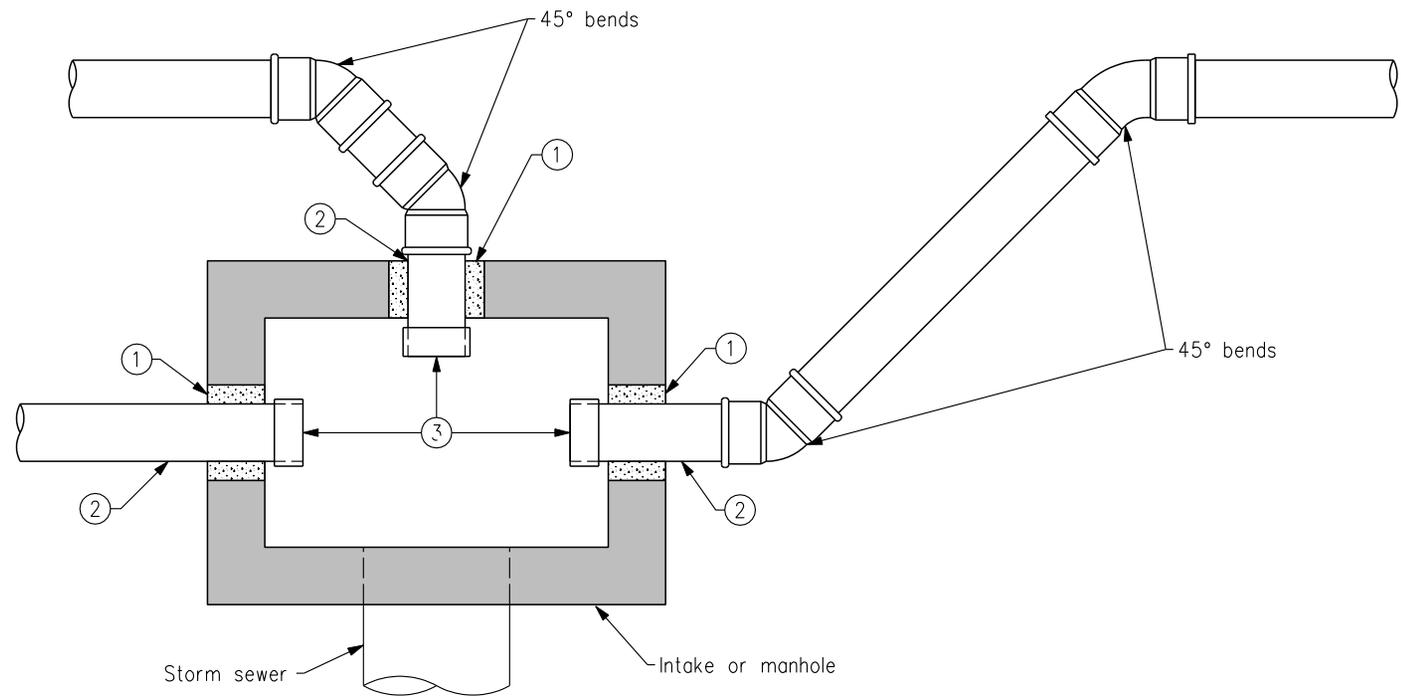

PLAN VIEW

FIGURE 4040.233 SHEET 1 OF 1

 <b>SUDAS</b>	REVISION	
	NEW	10/21/08
	<b>FIGURE 4040.233</b>	
SHEET 1 OF 1		

**SUBDRAIN OUTLETS**