


Water service

SECTION

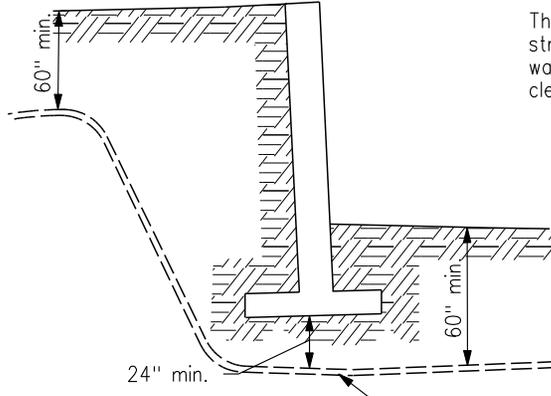


24" min.

Water service


SECTION

GENERAL NOTES:

This figure details minimum required clearances between structure and water service lines. Adjust location of water services as directed by the Engineer to maintain the clearances shown.

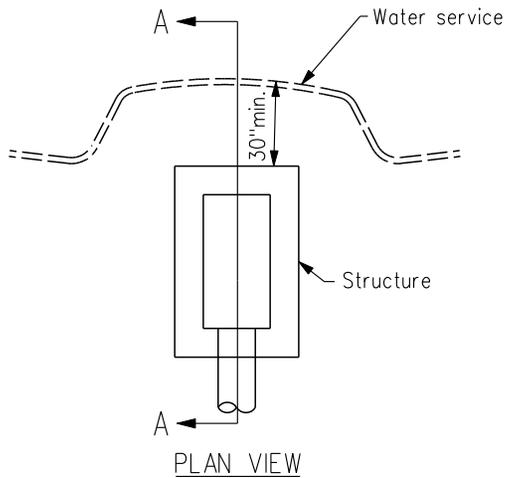

PLAN VIEW

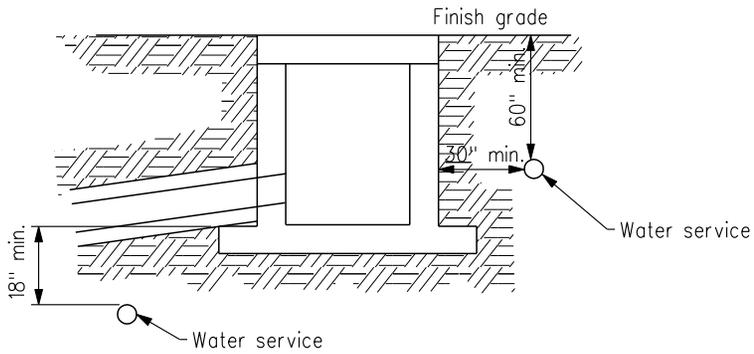

SECTION

FIGURE 5010.901 SHEET 1 OF 1

 SUDAS	REVISION	
	NEW	10/21/08
	FIGURE 5010.901	
SHEET 1 OF 1		

**MINIMUM CLEARANCE BETWEEN
WATER SERVICE AND STRUCTURE**