


FRAME PATTERNS FOR VARIOUS GATE OPENINGS

- ① Double swing gate is required only for widths greater than 16 feet. Exact details of gate design are subject to approval of the Engineer. Furnish gate with approved stop, latch, and means for locking. Install as recommended by the manufacturer.
- ② End post used to terminate run of fence if no gate is proposed.
- ③ Horizontal members are required only if the fabric height is 8 feet or greater.

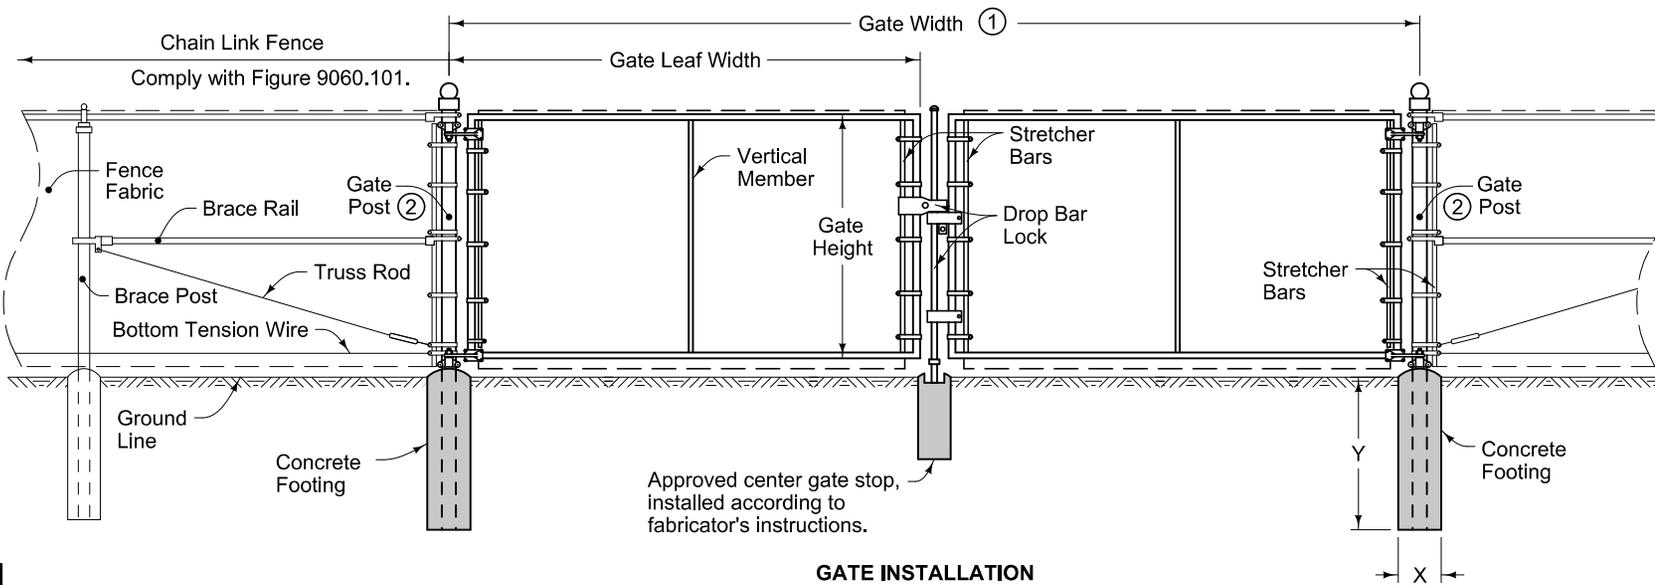

GATE INSTALLATION

GATE POST FOOTING DEPTH AND DIAMETER

GATE HEIGHT	GATE LEAF WIDTH	X	Y
6'-0" or less	4'-0" or less	0'-10"	3'-0"
6'-0" or less	over 4'-0" to 10'-0"	0'-12"	3'-0"
6'-0" or less	over 10'-0" to 18'-0"	1'-2"	3'-0"
over 6'-0"	6'-0" or less	0'-10"	3'-0"
over 6'-0"	over 6'-0" to 12'-0"	1'-0"	3'-0"
over 6'-0"	over 12'-0" to 18'-0"	1'-4"	3'-6"
over 6'-0"	over 18'-0" to 24'-0"	1'-6"	4'-0"

FIGURE 9060.102 SHEET 1 OF 1

 SUDAS	<small>REVISION</small> New 10-18-11
	9060.102
	<small>SHEET 1 of 1</small>
SUDAS Standard Specifications	
CHAIN LINK GATE	