



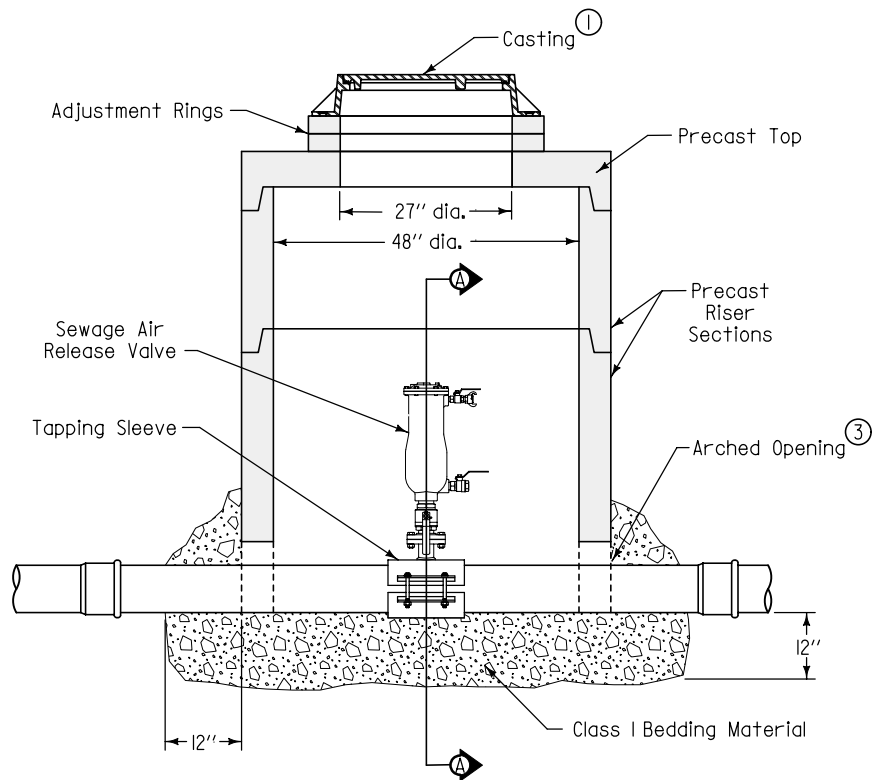

TYPICAL SECTION

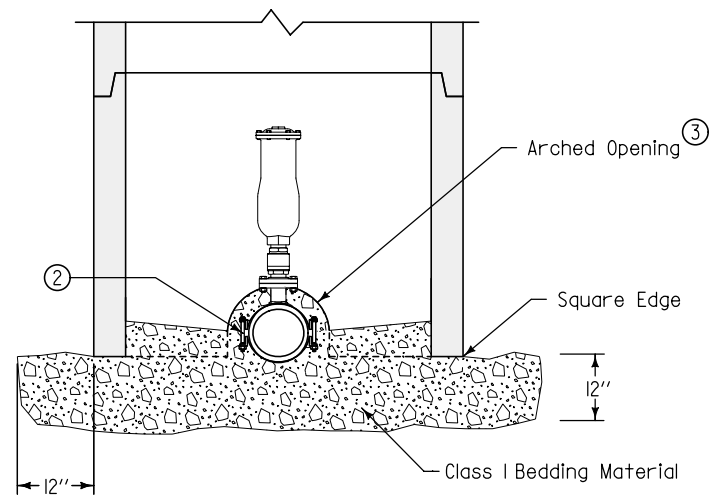

SECTION A-A

- ① SW-60I Type A or SW-602 Type G casting.
- ② Place bedding material to springline of pipe.
- ③ Prevent riser from bearing on pipe by providing an arched opening with a diameter up to 6 inches larger than pipe diameter.

 SUDAS	 Iowa Department of Transportation	REVISION	
		NEW	04-21-09
		FIGURE 4010.202	
		STANDARD ROAD PLAN	
		SW-202	
		SHEET 1 of 1	
REVISIONS: New. Replaces SUDAS Figure 4010.3			
 SUDAS DIRECTOR		 DESIGN METHODS ENGINEER	
SEWAGE AIR RELEASE VALVE PIT			