




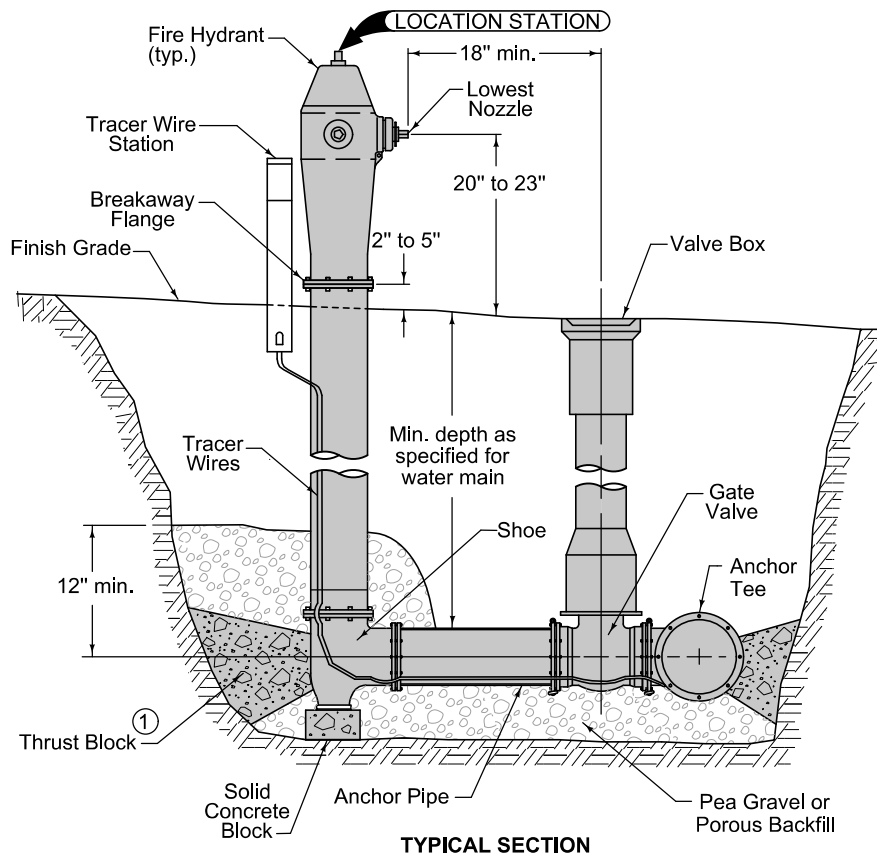

TYPICAL SECTION

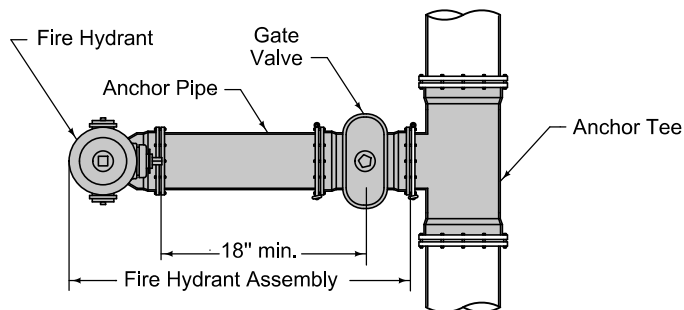

TYPICAL PLAN

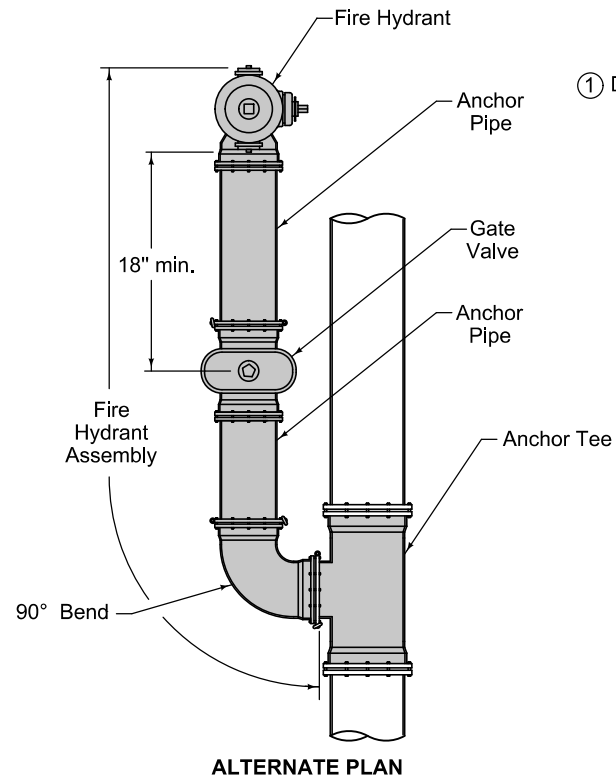

ALTERNATE PLAN

Use ductile iron pipe with restrained mechanical joints for fire hydrant assembly and anchor tee.

① Do not cover drain holes or tracer wire.

SUDAS	Iowa Department of Transportation	REVISION
		1 04-19-11
FIGURE 5020.201	STANDARD ROAD PLAN	WM-201
		SHEET 1 of 1
REVISIONS: Deleted Note 1 and references, renumbered Note 2, and deleted "typ" after "Tracer Wire Station".		
Paul D. Weigand SUDAS DIRECTOR		Deanna Markfort DESIGN METHODS ENGINEER
FIRE HYDRANT ASSEMBLY		