



Adjacent walls may have different widths based upon pipe configuration, but structure must be rectangular.

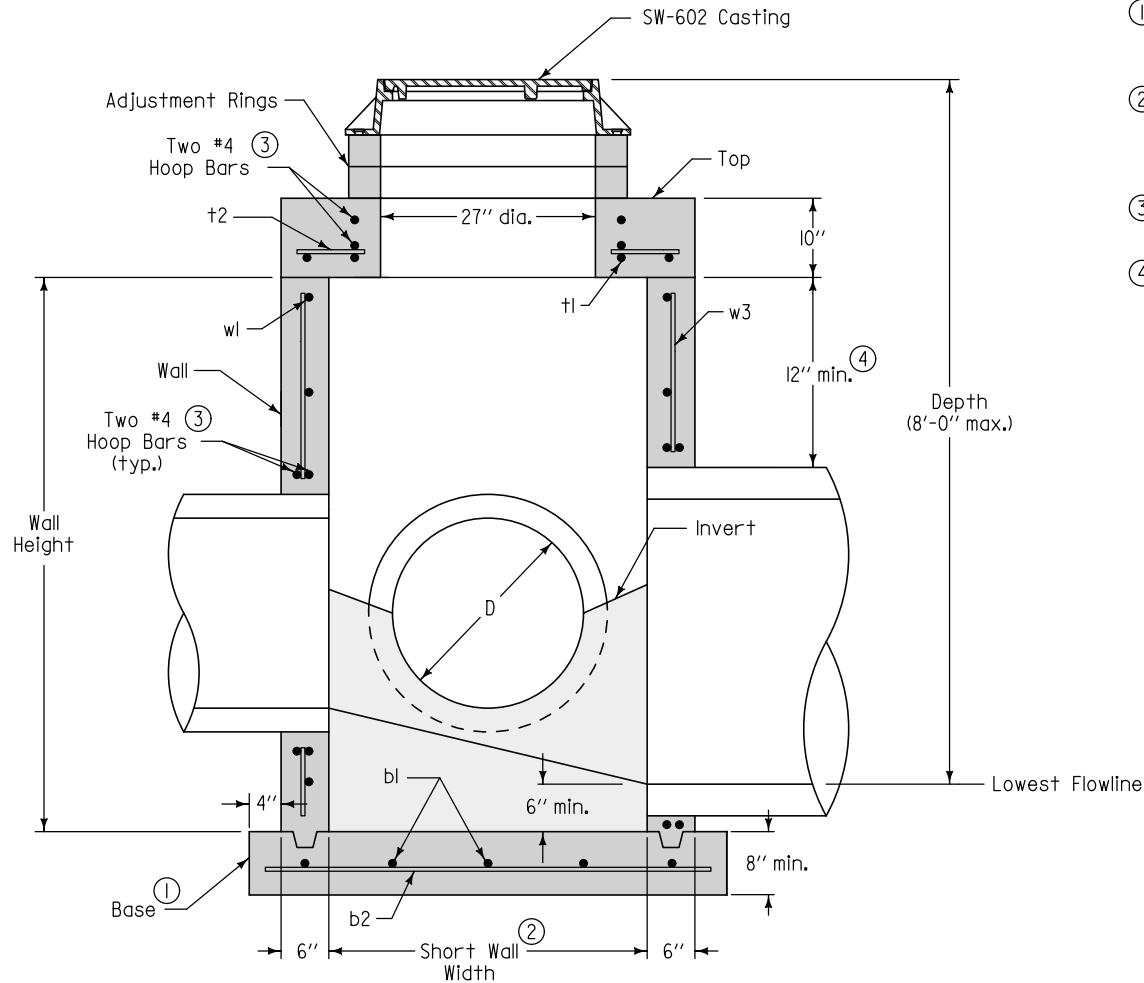

TYPICAL SECTION

- ① Cast-in-place base shown. If base is precast integral with walls, the footprint of the base is not required to extend beyond the outer edge of the walls.
- ② Wall widths vary with pipe diameter and range from 40 inches minimum to 77 inches maximum. Provide 6 inches of wall width (minimum) each side of pipe opening.
- ③ Provide two #4 hoop bars at top opening and at all pipe openings.
- ④ 12 inch minimum wall height above all pipes.

 SUDAS	 Iowa Department of Transportation	REVISION		
		NEW	04-21-09	
FIGURE 6010.402		SW-402		
STANDARD ROAD PLAN				
		SHEET 1 of 2		
REVISIONS: New. Replaces SUDAS Type "M-B" Manhole. Will replace RA-49.				
 SUDAS DIRECTOR		 DESIGN METHODS ENGINEER		
RECTANGULAR STORM SEWER MANHOLE				

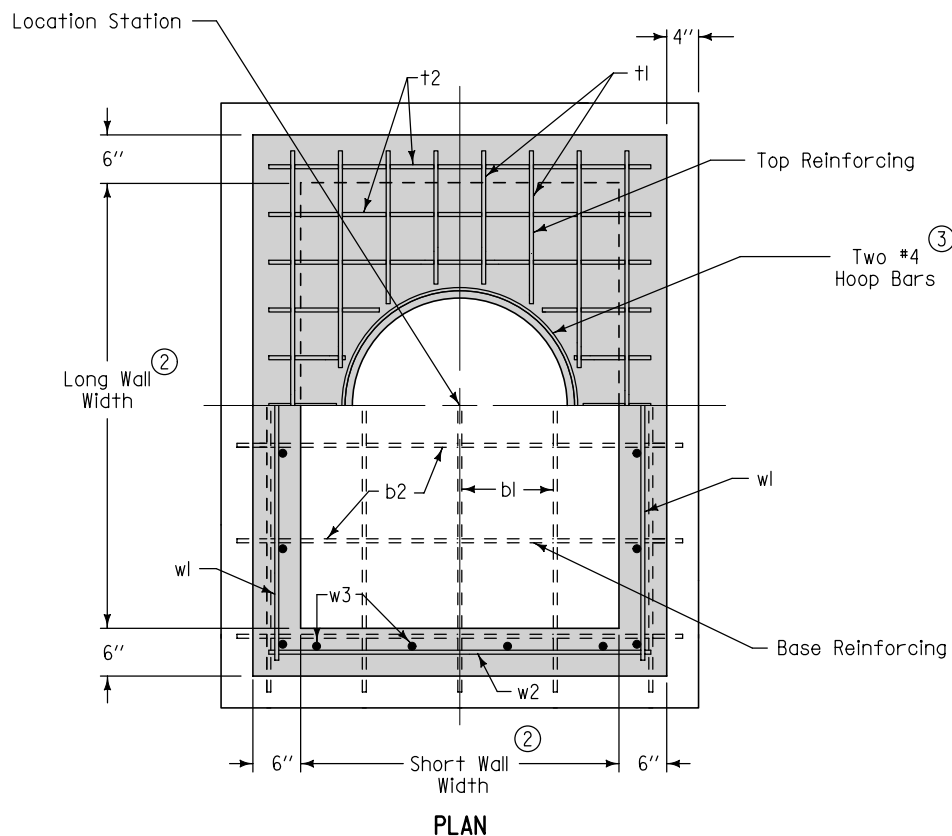

- ② Wall widths vary with pipe diameter and range from 40 inches minimum to 77 inches maximum. Provide 6 inches of wall width (minimum) each side of pipe opening.
- ③ Provide two #4 hoop bars at top opening and at all pipe openings.

FIGURE 6010.402 SHEET 2 OF 2

REINFORCING BAR LIST					
Mark	Size	Location	Shape	Length	Spacing
t1	See Table	Top	—	Long Wall plus 8"	6"
t2	See Table	Top	—	Short Wall plus 8"	6"
b1	See Table	Base	—	Long Wall plus 14"	12"
b2	See Table	Base	—	Short Wall plus 14"	12"
w1	See Table	Walls	—	Long Wall plus 8"	12"
w2	See Table	Walls	—	Short Wall plus 8"	12"
w3	See Table	Walls	—	Wall Height minus 4"	12"

Diameter of Largest Pipe, D	Minimum Bar Size
48" or 54"	6
33" to 42"	5
30" or smaller	4

SUDAS	Iowa Department of Transportation	REVISION
		NEW 04-21-09
		SW-402
FIGURE 6010.402	STANDARD ROAD PLAN	SHEET 2 of 2
REVISIONS: New, Replaces SUDAS Type "M-B" Manhole. Will replace RA-49.		
SUDAS DIRECTOR		DESIGN METHODS ENGINEER
RECTANGULAR STORM SEWER MANHOLE		