


- ① Barrel length and diameter as specified in the contract documents.
- ② Riser pipe and base/dewatering device: See Figure 9040.15.
- ③ Anti-vortex device: See Figure 9040.16.

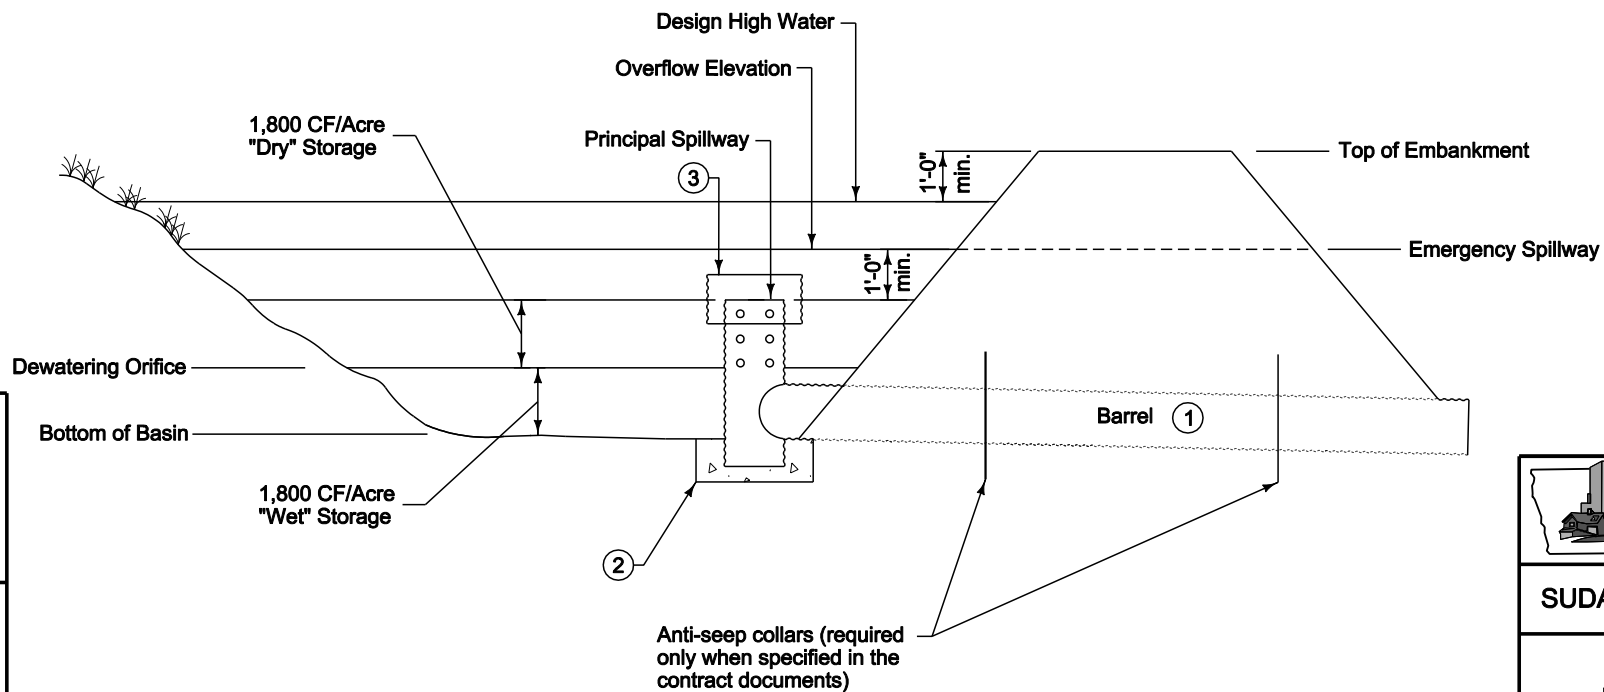

|                                                                                       |                                |          |
|---------------------------------------------------------------------------------------|--------------------------------|----------|
|  | REVISION                       |          |
|                                                                                       | 1                              | 10-18-11 |
|                                                                                       | <b>9040.14</b><br>SHEET 1 of 1 |          |
| SUDAS Standard Specifications                                                         |                                |          |
| SEDIMENT BASIN WITH EMERGENCY SPILLWAY                                                |                                |          |