


- ① Entrance length: 50 foot minimum (30 foot for single family residential), or as specified in the contract documents. Length of entrance may be increased if sediment track-out occurs.

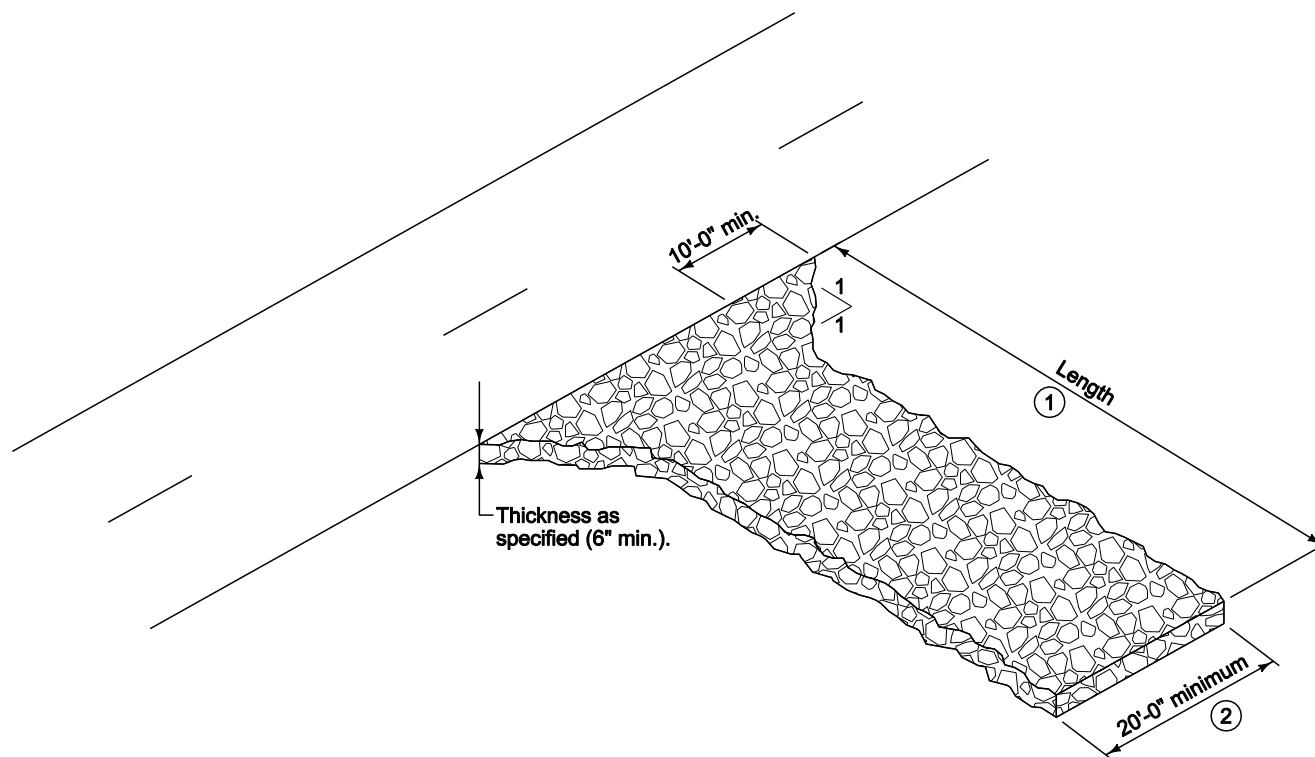

	REVISION	
	1	10-18-11
	9040.20	
	SHEET 1 of 1	

SUDAS Standard Specifications

STABILIZED CONSTRUCTION ENTRANCE