


- ① Entrance length: 50 foot minimum (30 foot for single family residential), or as specified in the contract documents. Length of entrance may be increased if sediment track-out occurs.

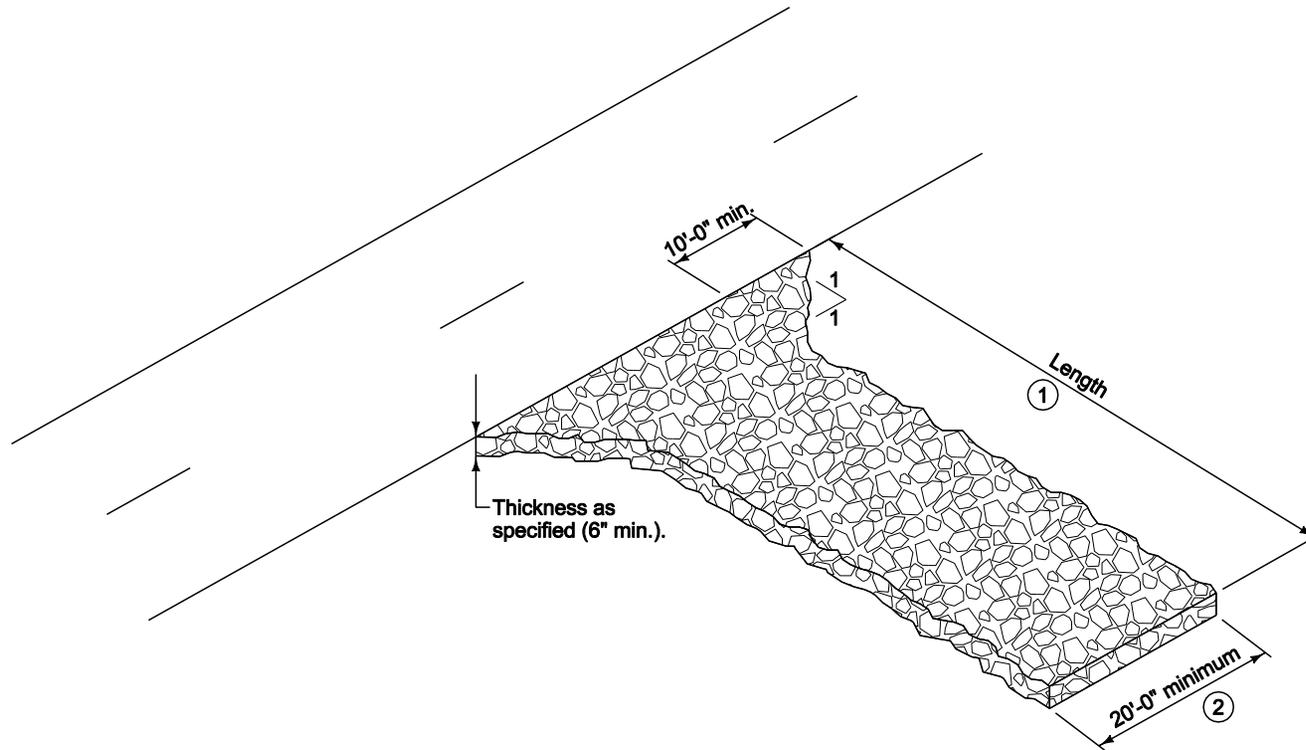

 SUDAS	REVISION
	1 10-18-11
	9040.20
SHEET 1 of 1	
SUDAS Standard Specifications	
STABILIZED CONSTRUCTION ENTRANCE	