




SECTION - TYPICAL INSTALLATION AT CL

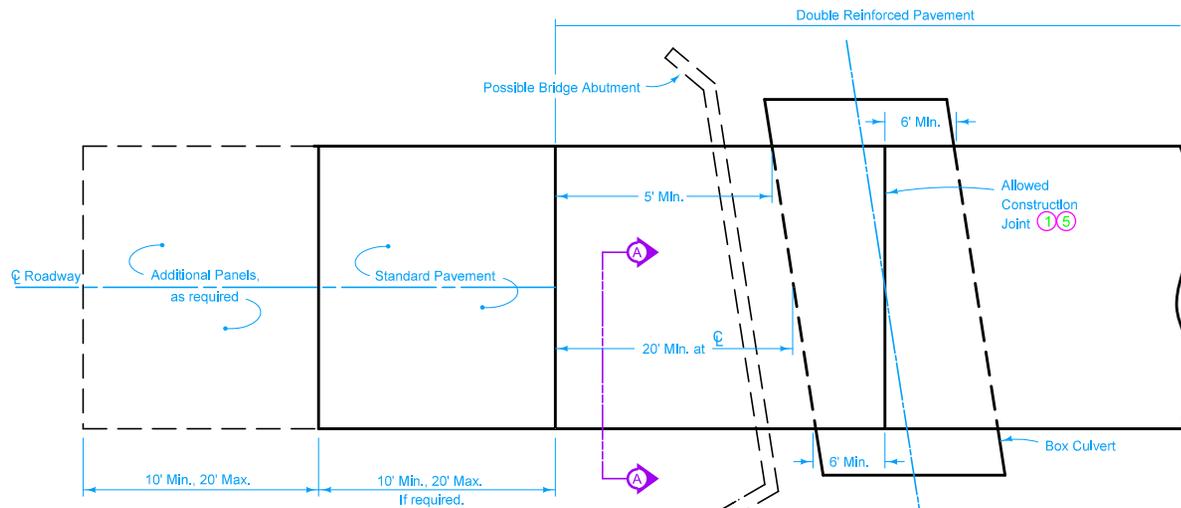

PLAN - TYPICAL INSTALLATION

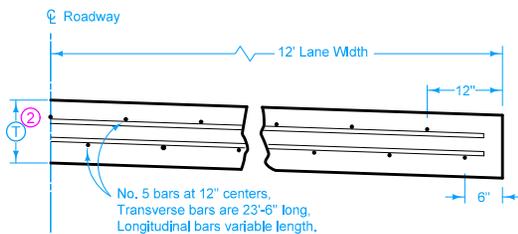

SECTION A-A  
Half Section

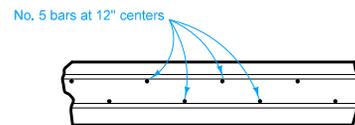

DETAIL 'A'  
PARTIAL LONGITUDINAL SECTION

Price bid for standard pavement of the specified thickness is full compensation for constructing the pavement as detailed hereon and elsewhere in the plans, including all necessary reinforcement and expansion joints as required on this project.

See PV-101 for joint details.

Provide minimum 2" clear for all reinforcement.

- 1 Construction Joints will be allowed if:
  - A. Joint is located at center of culvert.
  - B. Joint is a minimum of 6 feet from edge of culvert.
  - C. Two joints may be used if condition B is met and center panel is a minimum of 15 feet away.
- 2 Refer to typical sections elsewhere in plans for pavement thickness, T. Minimum T- 8 inches.
- 3 Existing Pavement Joints:
  - A. When joints are 'C'; use 'B' joint.
  - B. When joints are 'CD'; use 'RD' joint.
  - C. If existing pavement is HMA or Composite (HMA over PCC); use 'B' joint.
- 4 New Pavement Joints:
  - A. When joints are 'C'; use 'B' joint.
  - B. When joints are 'CD'; use 'CD' joint.
- 5 Lap all bars 15 inches.
- 6 Limits of excavation and type of backfill are shown elsewhere on the plan.

	REVISION
	NEW 10-21-14
<b>STANDARD ROAD PLAN</b>	<b>PR-120</b>
SHEET 1 of 1	
<small>REVISIONS: New. Replaces RR-23.</small>	
 <small>APPROVED BY DESIGN METHODS ENGINEER</small>	
<b>DOUBLE REINFORCED PAVEMENT OVER BOX CULVERTS</b>	