

Construct drop and overflow from ductile iron pipe of same diameter specified for sewer main. Provide mechanical joints for all ductile iron pipe and fittings.

- ① Place Class I bedding material, CLSM, flowable mortar, or concrete from top of elbow to bottom of sewer main.
- ② Encase elbow in concrete. 12 inches minimum on all sides.

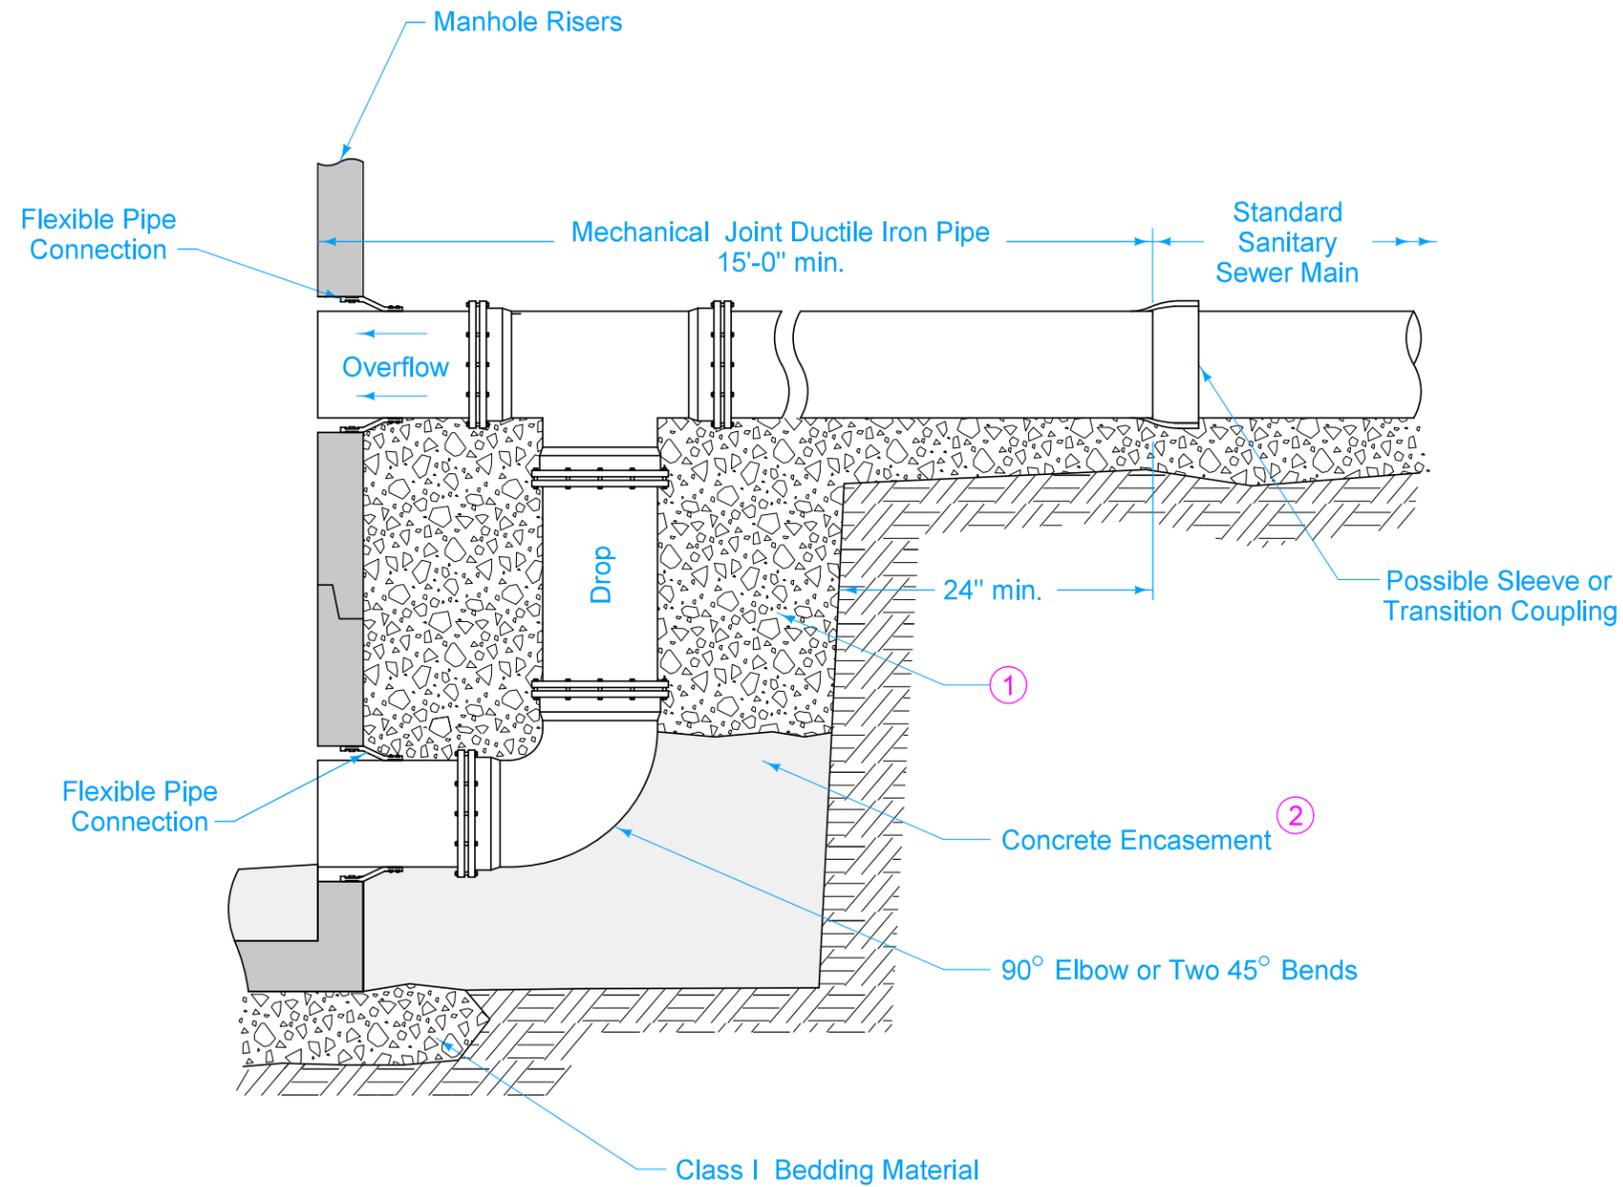


FIGURE 6010.307 | SHEET 1 OF 1

		REVISION	
		3	10-21-25
FIGURE 6010.307	STANDARD ROAD PLAN	<b>SW-307</b>	
		SHEET 1 of 1	

REVISIONS: Updated Sudas and IDOT Logos.

SUDAS DIRECTOR
 DESIGN METHODS ENGINEER

**EXTERNAL DROP CONNECTION FOR  
SANITARY SEWER MANHOLE**